


METER SINGLE SERVICE
SIDE VIEW


MARK NO.	DESCRIPTION
①	Water Meter (Combo Meter or approved equivalent) with flange adaptor purchased from council
②	Flange adaptor purchased from Council
③	S/Steel quarter turn ball valve F-F
④	Stainless Steel Elbow
⑤	316 Stainless Steel fixed length pipe to be purchased from Council (or approved equivalent supplier)
⑥	Polyethylene HDPE PN 16
⑦	Approved back flow prevention device to suit specific internal hazard, as per AS 3500
⑧	Gunmetal tapping band or Ready Tap Connection
⑨	Poly TPR bonnet poly ferrule stop cock
⑩	Stainless steel nipple adaptor
⑪	FI-Poly end connector

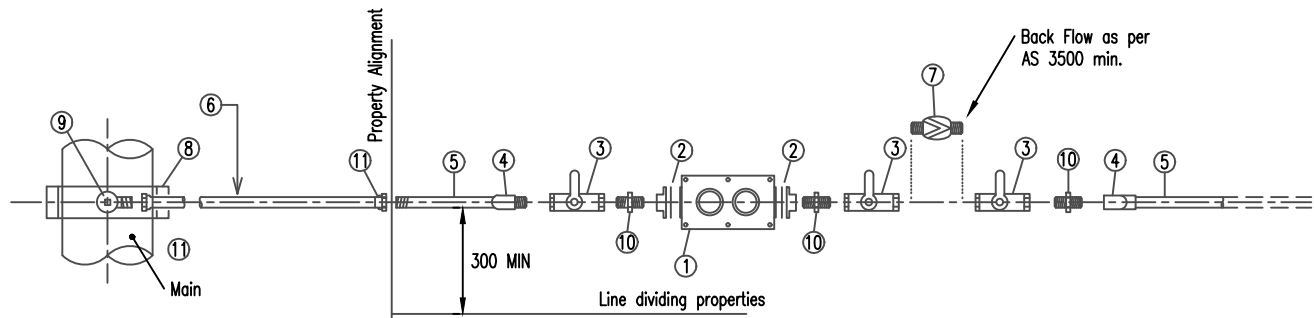

METER SINGLE SERVICE
PLAN VIEW

NOTES:

- Polythene pipe and connectors:
 - All polyethylene pipe shall be blue line HDPE PN16 as per AS4130
 - All mechanical joint fittings shall be in accordance with AS4129
- Cross road services shall be located 1000mm from dividing allotments so as not to conflict with electrical supply authority poles.
- Service pipes to lots other than a single dwelling shall have the service connection pipes upgraded to suit the use. These sizes should be sized to comply with AS3500
- All dimensions in millimetres.

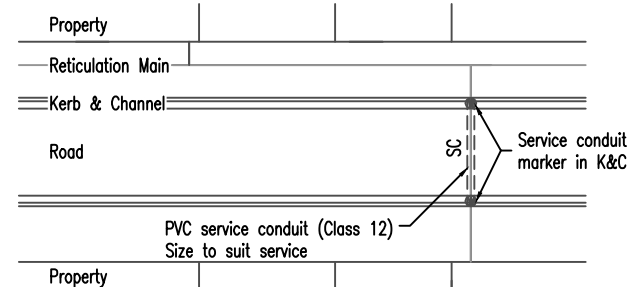

TYPICAL MAIN CONNECTIONS
PLAN VIEW

REVISIONS	DATE
D DEVELOPMENT MANUAL UPDATES AND AMENDMENTS 2018	26/10/18
C GENERAL UPDATES AND STANDARD REFERENCING AMENDMENTS	27/4/16
B GENERAL UPDATES	11/4/12
A ORIGINAL ISSUE	08/10



Email: info@whitsundayrc.qld.gov.au Web: www.whitsundayrc.qld.gov.au

BOWEN
67 Herbert St
Bowen 4805 Q
Ph 07 4761 3600

COLLINSVILLE
Cnr Stanley & Conway Sts
Collinsville 4804 Q
Ph 07 4785 5366

PROSERPINE
83-85 Main St
Proserpine 4800 Q
Ph 07 4945 0200

DOMESTIC/COMMERCIAL
WATER SERVICE/METER
(50 to 100mm DIAMETER)

WATER
Standard
Drawing
W-0100

A	B	C	D
---	---	---	---