



TYPICAL SECTION
RURAL ROAD CROSSINGS

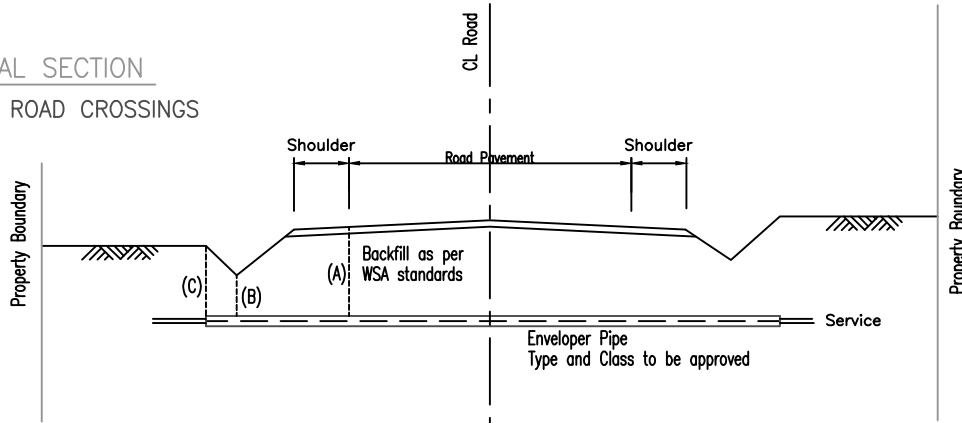

TYPICAL SECTION
URBAN ROAD CROSSINGS

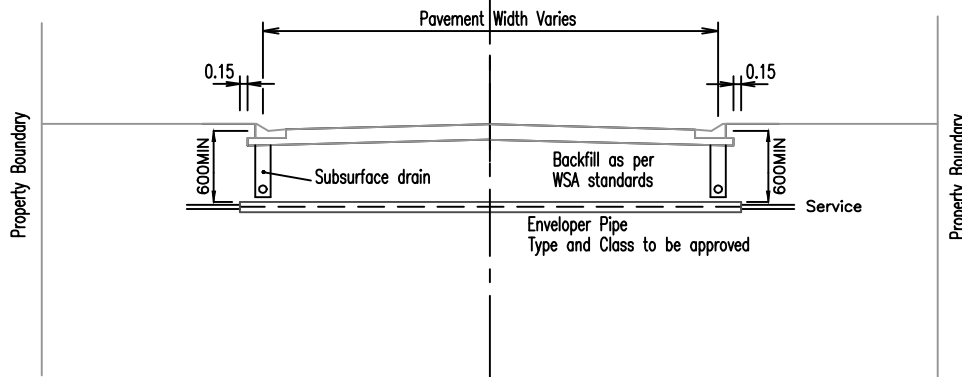

NOTES:

1. Backfilling of trench as per Water Services Australia (WSA) Code.
2. For enveloper pipe class details and treatments refer to WSA Standard Drawings 1212 and 1214.
3. Minimum depth of cover to top of enveloper pipe
 - (A) 600mm below road surface (measured from edge of seal),
 - (B) 450mm below lowest level of table drain, or
 - (C) 600mm below natural Surface, whichever is the lowest.
4. Where there is no Bitumen seal, the Lean Mix Concrete is to be continued to 150mm below surface level of road.
5. All work shall be in accordance with WSA Code including requirements for minimum lateral separation distances between adjoining horizontal services.

F	DEVELOPMENT MANUAL UPDATES AND AMENDMENTS 2018	26/10/18
E	GENERAL UPDATES AND STANDARD REFERENCING AMENDMENTS	27/4/16
D	GENERAL UPDATES	27/3/12
C	"OUTSIDE DECLARED WATER AREA" BLOCK, STAR PKT. TO BOUNDARY	11/7/07
B	QT ROAD BORING ADDED	10/3/98
A	ORIGINAL ISSUE	1/3/97
REVISIONS		DATE



Email: info@whitsundayrc.qld.gov.au Web: www.whitsundayrc.qld.gov.au

BOWEN
67 Herbert St
Bowen 4805 Q
Ph 07 4761 3600

COLLINSVILLE
Cnr Stanley & Conway Sts
Collinsville 4804 Q
Ph 07 4785 5366

PROSERPINE
83-85 Main St
Proserpine 4800 Q
Ph 07 4945 0200

ROAD CONDUIT CROSSINGS FOR
WATER AND IRRIGATION LINES
(100mm TO 800mm ø)

WATER
Standard
Drawing
W-0042

B | C | D | E | F