



**NOTES:**

1. Flanged DICL pipe to suit or as otherwise approved by Council.
2. Combination Bypass Meter (Size of meters to be determined for use.) as per requirements and details in AS/NZS 3500.1.
3. Bypass Meter must be able to be isolated and operate independently from the rest of service.
4. Isolating valves shall either be gear operated butterfly valves for fire services or resilient sluice valves to suit fire services
5. The Isolating Valves must be able to be locked in open position.
6. Back-flow Prevention Device (BPD) shall be sourced from Council's preferred supplier.
7. Check valve for low hazard application shall be used.
8. All works are to comply with AS 3500.1 for water supply and
  - (a) AS 2419.1, fire hydrant installation
  - (b) AS 2845.1, back flow prevention devices
9. Materials, design and performance requirements shall be in accordance with Council policy, sewerage and water supply act.
10. Sizing to be indicated on plans as required.
11. Class of pipe shall be mPVC class 16 series 2 or DI PN20

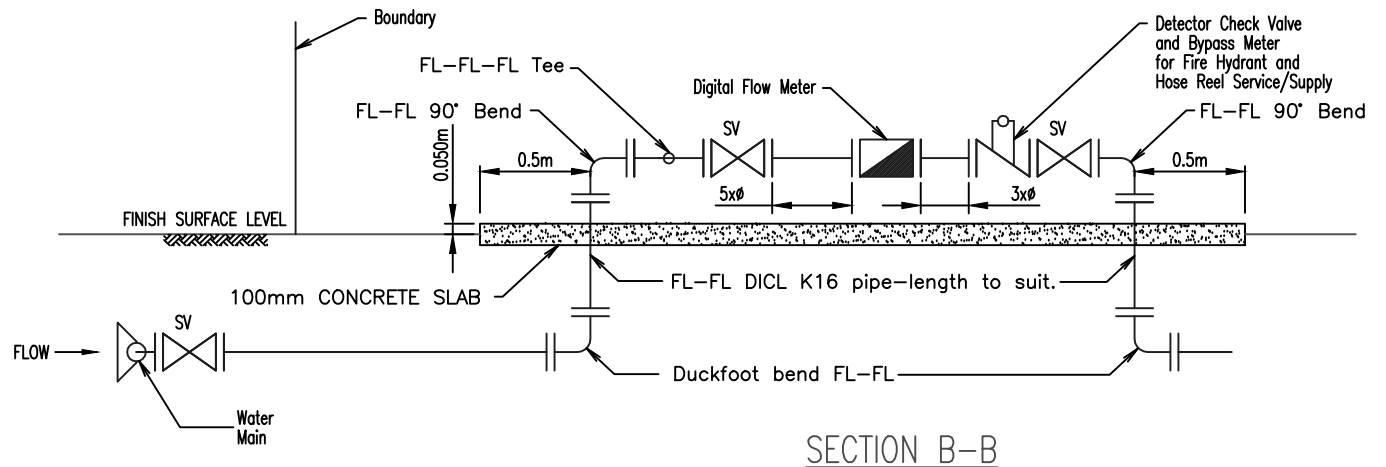

A	DEVELOPMENT MANUAL UPDATES AND AMENDMENTS 2018	26/10/18
	REVISIONS	DATE

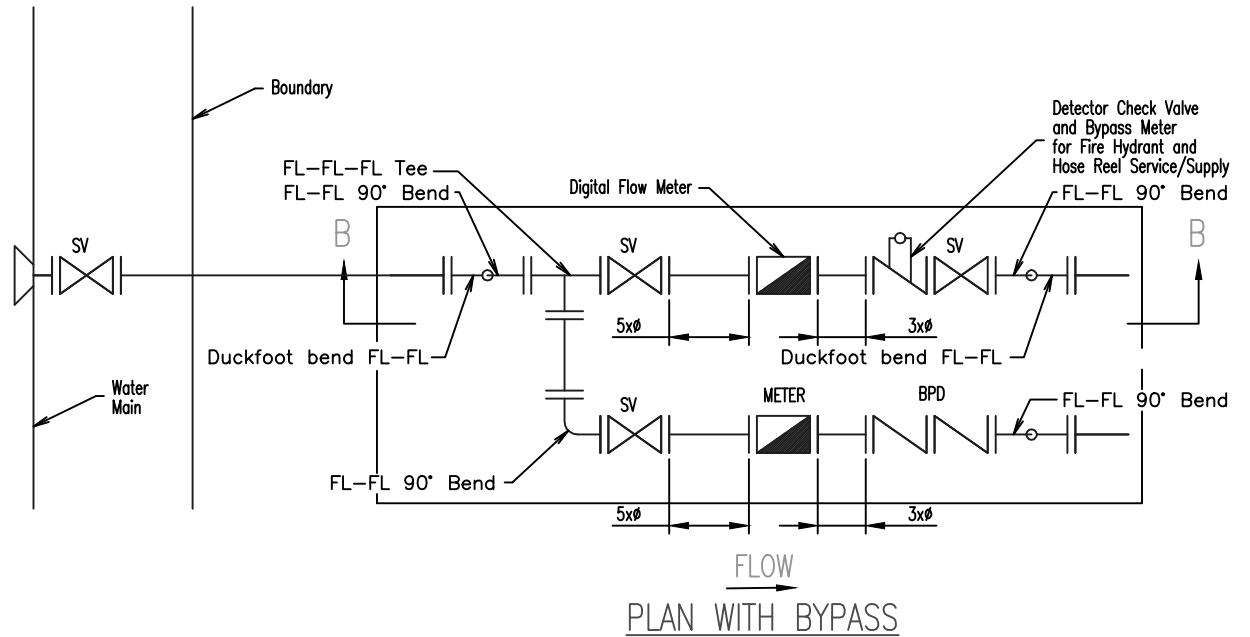

Email: [info@whitsundayrc.qld.gov.au](mailto:info@whitsundayrc.qld.gov.au) Web: [www.whitsundayrc.qld.gov.au](http://www.whitsundayrc.qld.gov.au)

**BOWEN**  
67 Herbert St  
Bowen 4805 Q  
Ph 07 4761 3600

**COLLINSVILLE**  
Cnr Stanley & Conway Sts  
Collinsville 4804 Q  
Ph 07 4785 5366

**PROSERPINE**  
83-85 Main St  
Proserpine 4800 Q  
Ph 07 4945 0200

WATER MAIN COMBINED  
FIRE AND DOMESTIC SUPPLY  
(WITH A BYPASS)

WATER  
Standard  
Drawing  
W-0094

A